

Annexure C

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No. 2026-27/103.

Dated: 09/04/2026

It is certified that an inspection team headed by Dr. B. Rathnayaka

(Name of Officers with designation) from District Water Testing Laboratory PHED

inspected the Shree Sahajanand International Gurukul V.V. Targa

(Name & Address of the school) on 09/04/2026 (date of inspection) and on the basis of

Water Test Report (Attached) bearing no. TC 75026000000025F dated 10/04/2026

of District Water Testing Lab. (PHED Lab) certified that

the Shree Sahajanand International Gurukul (Name of school) has safe drinking water

facilities for the students and members of staff of the institution. School is also maintains the

hygienic sanitation condition in the school building & the campus as per norms prescribed by the

Central/ State/ U.T. Govt.

This certificate is valid till 09/04/2027

Signature with Seal:

Name

Designation

Name & Address of the Officer: District Health Officer

CHC PATAN

Dist. Durg (C.G.)

To Principal

Shree Sahajanand International Gurukul

(Name & Address of the Institution) V.V. Targa, Dist. Durg C.G.

Note: The certificate is to be issued by authorized officer / PHED Lab / local bodies



District Water Testing Laboratory
Public Health Engineering Division Durg Chhattisgarh

Format Id- DL/PHED/DRG/F/4.1

Near Rajendra Park Chowk

E-mail eedurg-phe-cg@mail.nic.in , Phone 0788-2323633

Test Report
Group- Drinking Water

Sender's Name and Address:- श्री सहजानंद इंटरनेशनल, गुरुकुल, ग्राम-तर्रा जिला- दुर्ग (छ.ग.)	ULR No.:- TC750226000000025F		Sample Collected by- श्री सहजानंद इंटरनेशनल, गुरुकुल, ग्राम-तर्रा	
	Sender's letter no.	-	Sender's letter Date	09-04-2026
	DL Receipt No.	04/26/22	DL Received date	09-04-2026
	Date of analysis started	09-04-2026	Date of analysis completed	10-04-2026

Sample Details

No	Block & District	Village/Panchayat	Sample Id	Source/Location Details
1	पाटन / दुर्ग	तर्रा	116	ग्राम- तर्रा, जिला-पाटन (आर.ओ.का पानी)
2				
3				
4				
5				

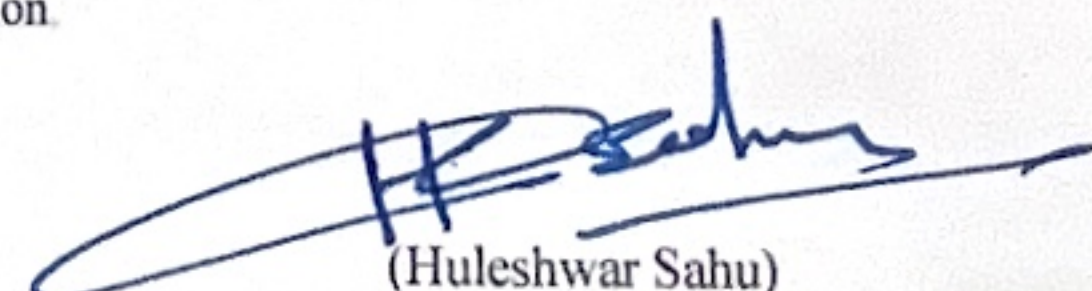
Details of parameters, their test methods, units and specifications as per IS/APHA

No.	Characteristics	Test method IS/APHA 24rd Edition		Unit of Measurement	As Per IS -10500:2012 For Drinking Water		Results						
					Acceptable Limit	Permissible Limit	1	2	3	4	5	6	7
1	2	3	4	5	6	7		-	-	-	-	-	-
		Method	Part No.		Sample ID -->		116	-	-	-	-	-	-
1	Turbidity	IS:3025	Part -10	NTU	1.0	5.0	0.2	-	-	-	-	-	-
2	pH at Temperature 25°C	IS:3025	Part -11	pH scale	6.5 - 8.5	6.5 - 8.5	6.62	-	-	-	-	-	-
3	Total Alkalinity as CaCO ₃	IS:3025	Part -23	mg/l	200	600	58.8	-	-	-	-	-	-
4	Specific Conductivity at Temperature 25°C	IS:3025	Part -14	μmhos/cm	-	-	216	-	-	-	-	-	-
5	Chloride as Cl ⁻	IS:3025	Part- 32	mg/l	250	1000	10.72	-	-	-	-	-	-
6	Total Hardness as CaCO ₃	IS:3025	Part -21	mg/l	200	600	89.76	-	-	-	-	-	-
7	Calcium as Ca ⁺⁺	IS:3025	Part -40	mg/l	75	200	13.08	-	-	-	-	-	-
8	Magnesium as Mg ⁺⁺	APHA	3500-Mg- B	mg/l	30	100	13.88	-	-	-	-	-	-
9	Nitrate as NO ₃ ⁻	APHA	4500-NO3-B	mg/l	45	45	0.048	-	-	-	-	-	-
10	Iron as Fe ⁺⁺	APHA	3500-Fe- B	mg/l	0.3	1.0	0.10	-	-	-	-	-	-
11	Manganese as Mn ⁺	APHA	3500-Mn-B	mg/l	0.1	0.3	0.0	-	-	-	-	-	-
12	Sulphate as SO ₄ ²⁻	IS:3025	Part- 24	mg/l	200	400	8.24	-	-	-	-	-	-
13	Fluoride as F ⁻	APHA	4500-F-C	mg/l	1.0	1.5	0.048	-	-	-	-	-	-
14	Total Dissolved Solid (TDS)	IS:3025	Part -16	mg/l	500	2000	132	-	-	-	-	-	-
15	Odour	IS:3025	Part -5		Agreeable	Agreeable	Agreeable	-	-	-	-	-	-
16	Color	APHA	2120 B	Hazen	5	15	4	-	-	-	-	-	-
17	Taste	IS:3025	Part -8		Agreeable	Agreeable	-	-	-	-	-	-	-

- 1 This report should not be produced partly or full without approval of signatory authority of legal purposes
- 2 It is recommended that acceptable limit is to be implemented. Values in excess of those mentioned under "acceptable" render the water not suitable, but still may be tolerated in the absence of an alternative source but upto the limits indicated under the "permissible limit in the absence of alternate source" in column 7 above which the sources will have to be rejected.
- 3 The results refer only to tested samples and parameters tested.
- 4 Samples will be stored for a period of 07 days from date of issue of report.
- 5 This lab does not hold any responsibility for variation in results for samples kept on hold for want of clarification.
- 6 The Laboratory does not give interpretation on Test result Passed / Failed
- 7 1. Results apply to the sample as received
2. Sampling not done by the Laboratory Staff

Issue No. 25/Lab/ Date- 13/04/2026

Page- 01 of 01
End of Test Report


(Huleshwar Sahu)
Authorised Signatory